


SEALED ROADS - Any Services placed under or within 1m of the sealed carriageway shall have a minimum of 900mm cover.
 UNSEALED ROADS - Any Services placed under the unsealed carriageway shall have a minimum of 900mm cover.

PATH NEXT TO KERB - IN MULTIPLE SINGLE CORE ELECTRICAL CABLE AREAS

NOTE:-

All trenches cut in road pavement shall be backfilled with TNZ M/4 basecourse aggregate. The backfill shall be compacted in accordance with TNZ B/2 and shall be constructed such that water shall not pond in the backfilled trench. A subsoil pipe outlet may be required.

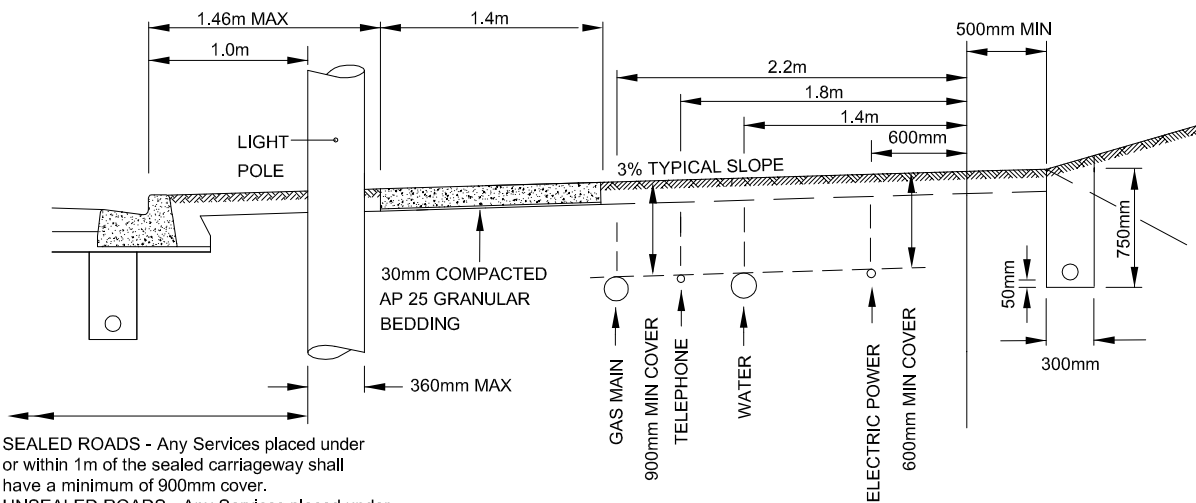

SEALED ROADS - Any Services placed under or within 1m of the sealed carriageway shall have a minimum of 900mm cover.
 UNSEALED ROADS - Any Services placed under the unsealed carriageway shall have a minimum of 900mm cover.

PATH SEPARATED FROM KERB - IN MULTIPLE SINGLE CORE ELECTRIC CABLE AREAS

NOTE:-

1. The footpath separated from the kerb is the preferred location.
2. All service connections shall pass below the 'under channel drain'.
3. No services are allowed within the formed road carriageway without the Engineer's written permission.



STANDARD DETAIL:

SERVICES LAYOUT AND BERM CROSS-SECTION FOR URBAN ROADS

DATE: June 2010
 NOT TO SCALE

TCDC NO:

SHEET NO:

REV:

3000

19

A