
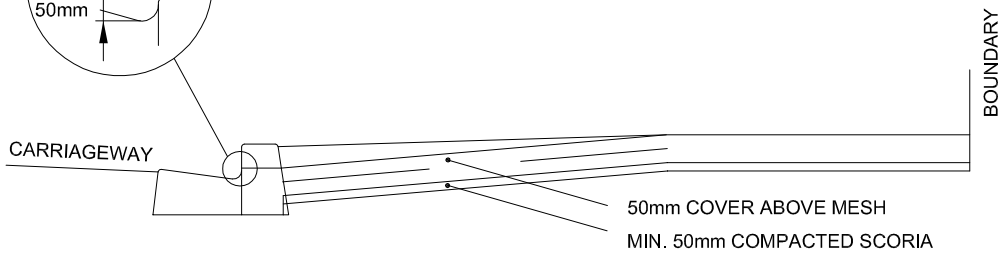


**PLAN**



**SECTION**

**NOTES:-**

1. Work must be inspected by the Council representative before any concrete is poured.
2. Concrete strength shall be 20 MPa at 28 days.
3. Excavation shall be fenced and lit at night.
4. Existing concrete to be cut out neatly and removed.
5. Brick or precast concrete paving units may be used only between the property boundary and the rear of the footpath to comply with NZS 3116:1981 Interlocking Concrete Paving.
6. Industrial crossing plan dimensions to be specifically designed, to accommodate all vehicle types that may be required to access the site.
7. Residential crossings to be min. 150mm thick. May be reduced to 110mm thick if one layer of 665 mesh used.
8. Industrial crossings shall be 200mm thick without mesh.
9. Crossings shall not be sited over or through traffic control devices or formed parking bays.



STANDARD DETAIL:

**VEHICLE CROSSING  
RESIDENTIAL K & C  
FOOTPATH IN BERM  
(OR NO FOOTPATH)  
(TYPE B)**

DATE: June 2010  
NOT TO SCALE

TCDC NO:

**3000**

SHEET NO:

**3**

REV:

**A**